
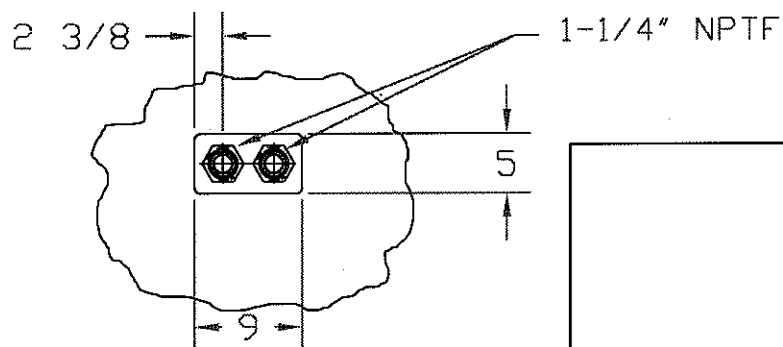
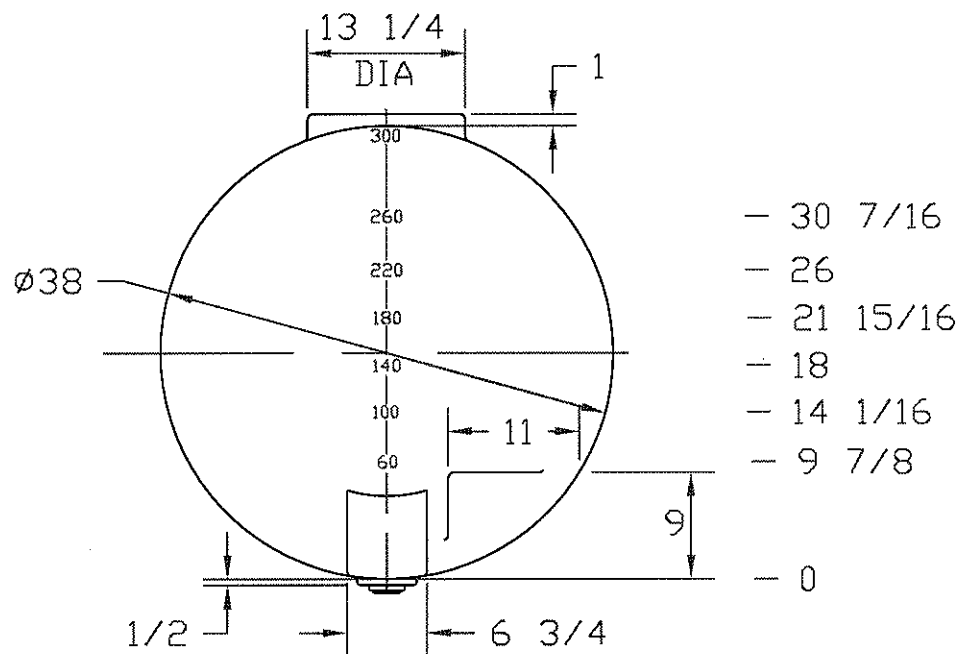


REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	C	REDRAWN	20AUG97	
	D	FITTINGS UPDATED	09DEC02	

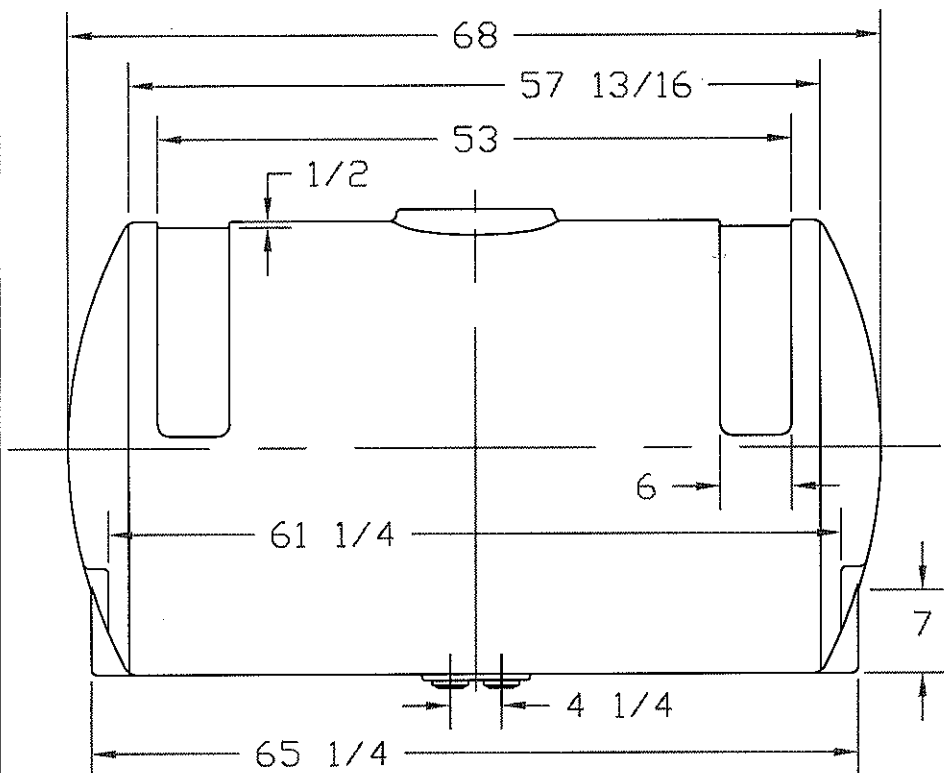

JTP 20AUG97		NORWESCO ST. BONIFACIUS, MN 300 GALLON APPLICATOR TANK		
		SIZE A	FSCM NO.	DWG NO.
SCALE 1/16		SHEET		

REV
D